



---

---

**WASHINGTON COUNTY PURCHASING DEPARTMENT**

Washington County Administration Building  
100 West Washington Street, Room 320  
Hagerstown, Maryland 21740-4748  
Telephone: 240-313-2330  
FAX: 240-313-2331  
Deaf and Hard of Hearing call 7-1-1 for Maryland Relay

---

---

**PUR-1095**

**ADDENDUM NO. 2**

**INVITATION TO BID**

**CITY OF HAGERSTOWN, MARYLAND  
SALEM AVENUE SANITARY SEWER REHABILITATION  
(CITY CONTRACT NUMBER 5485001-5881-C0799)**

**DATE: August 21, 2009**

**BIDS DUE: Wednesday, September 9, 2009  
2:00 P.M., DST**

To Bidders:

This Addendum is hereby made a part of the Contract Documents on which all bids will be based and is issued to correct and clarify the original documents.

Please acknowledge receipt of this Addendum at the appropriate space on the Proposal Form. This Addendum consists of two (2) pages and one (1) attachment.

**ITEM NO. 1:** Delete Standard Detail T-056 bound with the original bid set (revised Standard Detail T-056 provided in Addendum No. 1 issued on July 27, 2009).

**ITEM NO. 2:** Add Standard Detail TS-030 (attached).

**ITEM NO. 3:** A letter was sent to the City of Hagerstown requesting information on qualified DBE/MBE/WBE firms. Please note that a list of MBE and WBE firms compiled by the City of Hagerstown was included as an attachment to Addendum No. 1 issued on July 27, 2009. In addition, Item No. 3 of Addendum No. 1 deleted the requirement for bidders to include such a letter to the City of Hagerstown with bids.

**ITEM NO. 4:** *Inquiry: Is the testing (compaction, etc) the responsibility of the Contractor? Or will the County issue a separate RFP for testing? Or pull a vendor from an existing pre-qual list?*


*Response: Testing services are covered in Specification Section 01400.1, which requires the Contractor to provide and pay for all testing services and to obtain the Owner and/or Engineer's acceptance of testing firms utilized before services are performed.*

By Authority of:

A handwritten signature in cursive script that reads "Karen R. Luther Re." The signature is written in black ink and is positioned above the printed name and title.


Karen R. Luther, CPPO  
Purchasing Agent

BOARD OF COUNTY COMMISSIONERS  
OF WASHINGTON COUNTY, MARYLAND

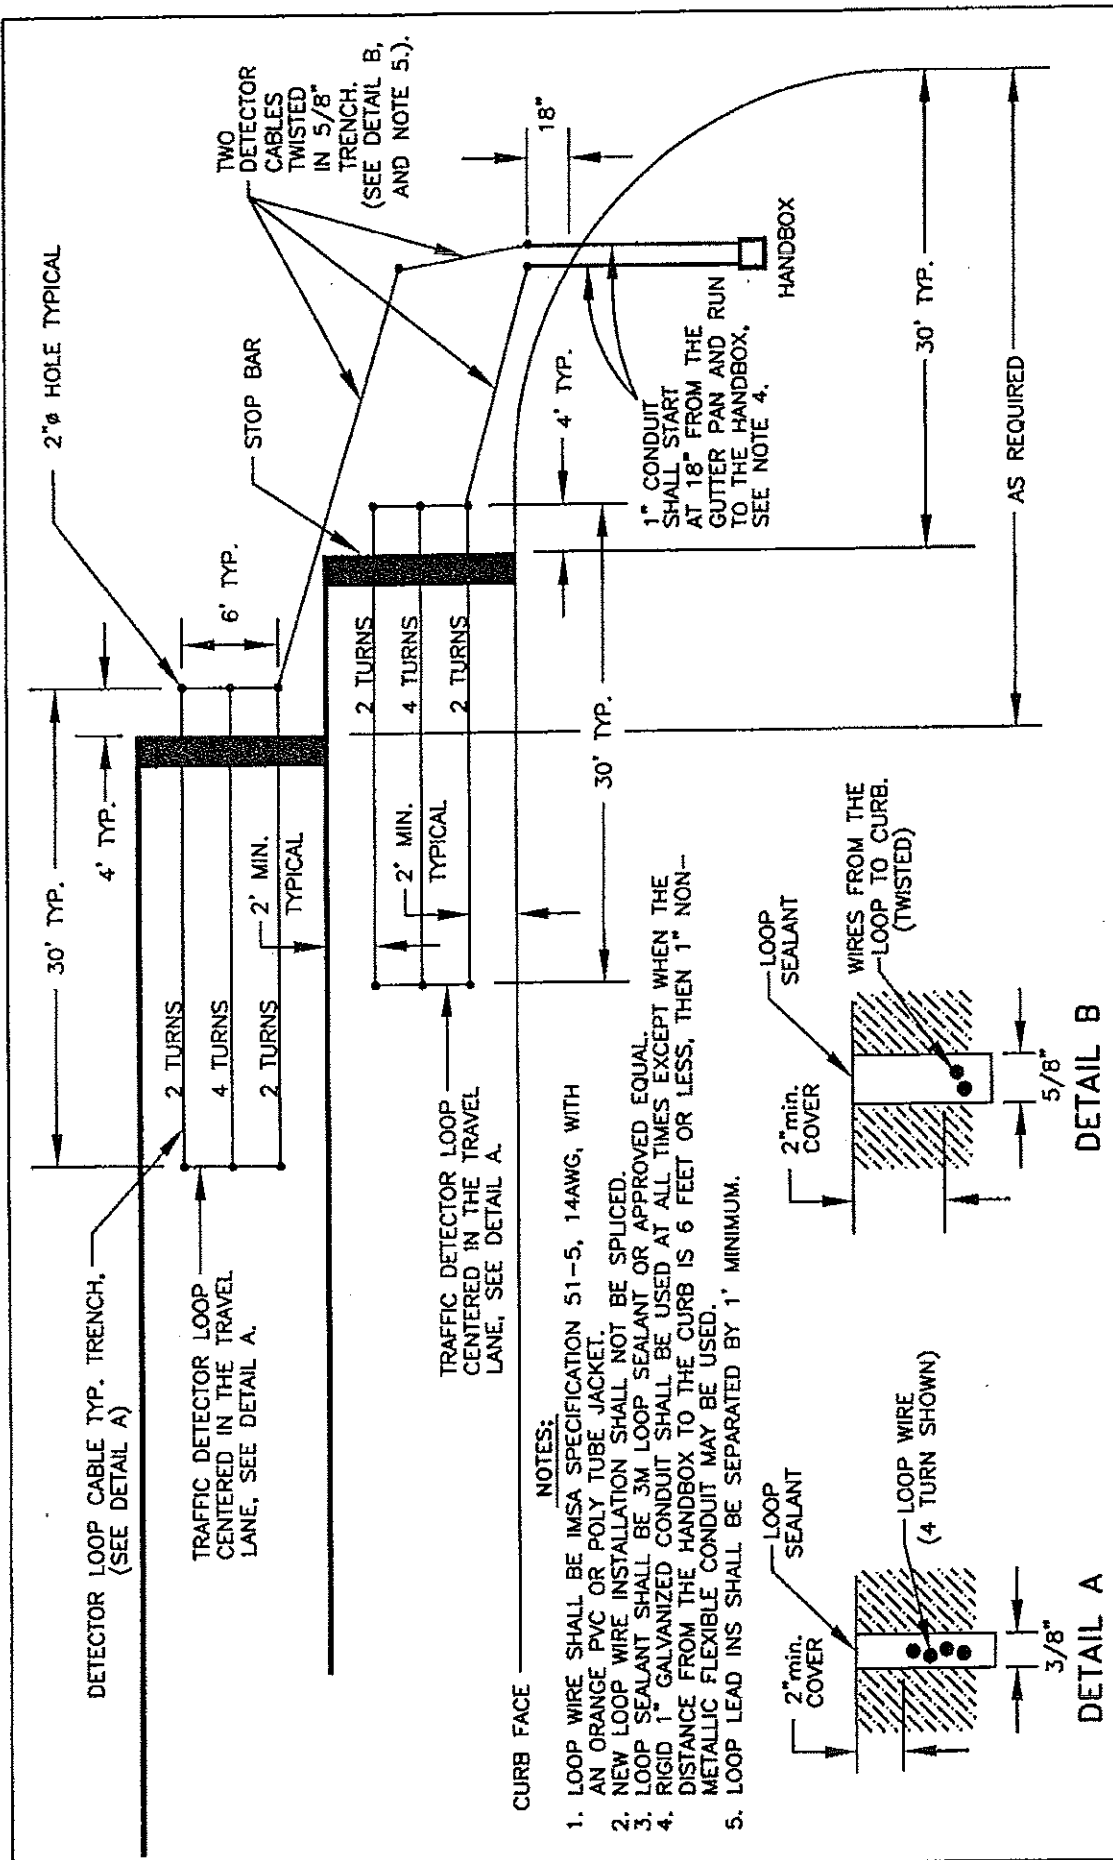


**NOTES:**

1. LOOP WIRE SHALL BE IMSA SPECIFICATION 51-5, 14AWG, WITH AN ORANGE PVC OR POLY TUBE JACKET.
2. NEW LOOP WIRE INSTALLATION SHALL NOT BE SPLICED.
3. LOOP SEALANT SHALL BE 3M LOOP SEALANT OR APPROVED EQUAL.
4. RIGID 1" GALVANIZED CONDUIT SHALL BE USED AT ALL TIMES EXCEPT WHEN THE DISTANCE FROM THE HANDBOX TO THE CURB IS 6 FEET OR LESS, THEN 1" NON-METALLIC FLEXIBLE CONDUIT MAY BE USED.
5. LOOP LEAD INS SHALL BE SEPARATED BY 1' MINIMUM.

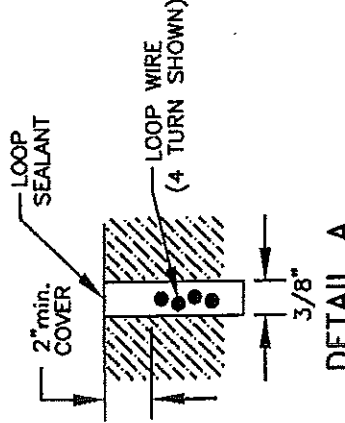

**DETAIL A**

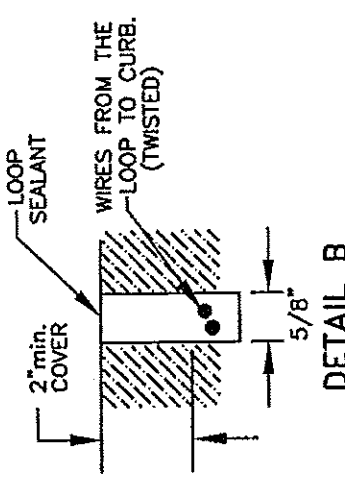

**DETAIL B**



CITY OF HAGERSTOWN, MARYLAND - ENGINEERING AND INSPECTIONS DEPARTMENT

**TRAFFIC SIGNAL STANDARD DETAIL  
DETECTOR LOOP**

ISSUE DATE: 01-01-03  
REVISIONS

Plate **TS-030**